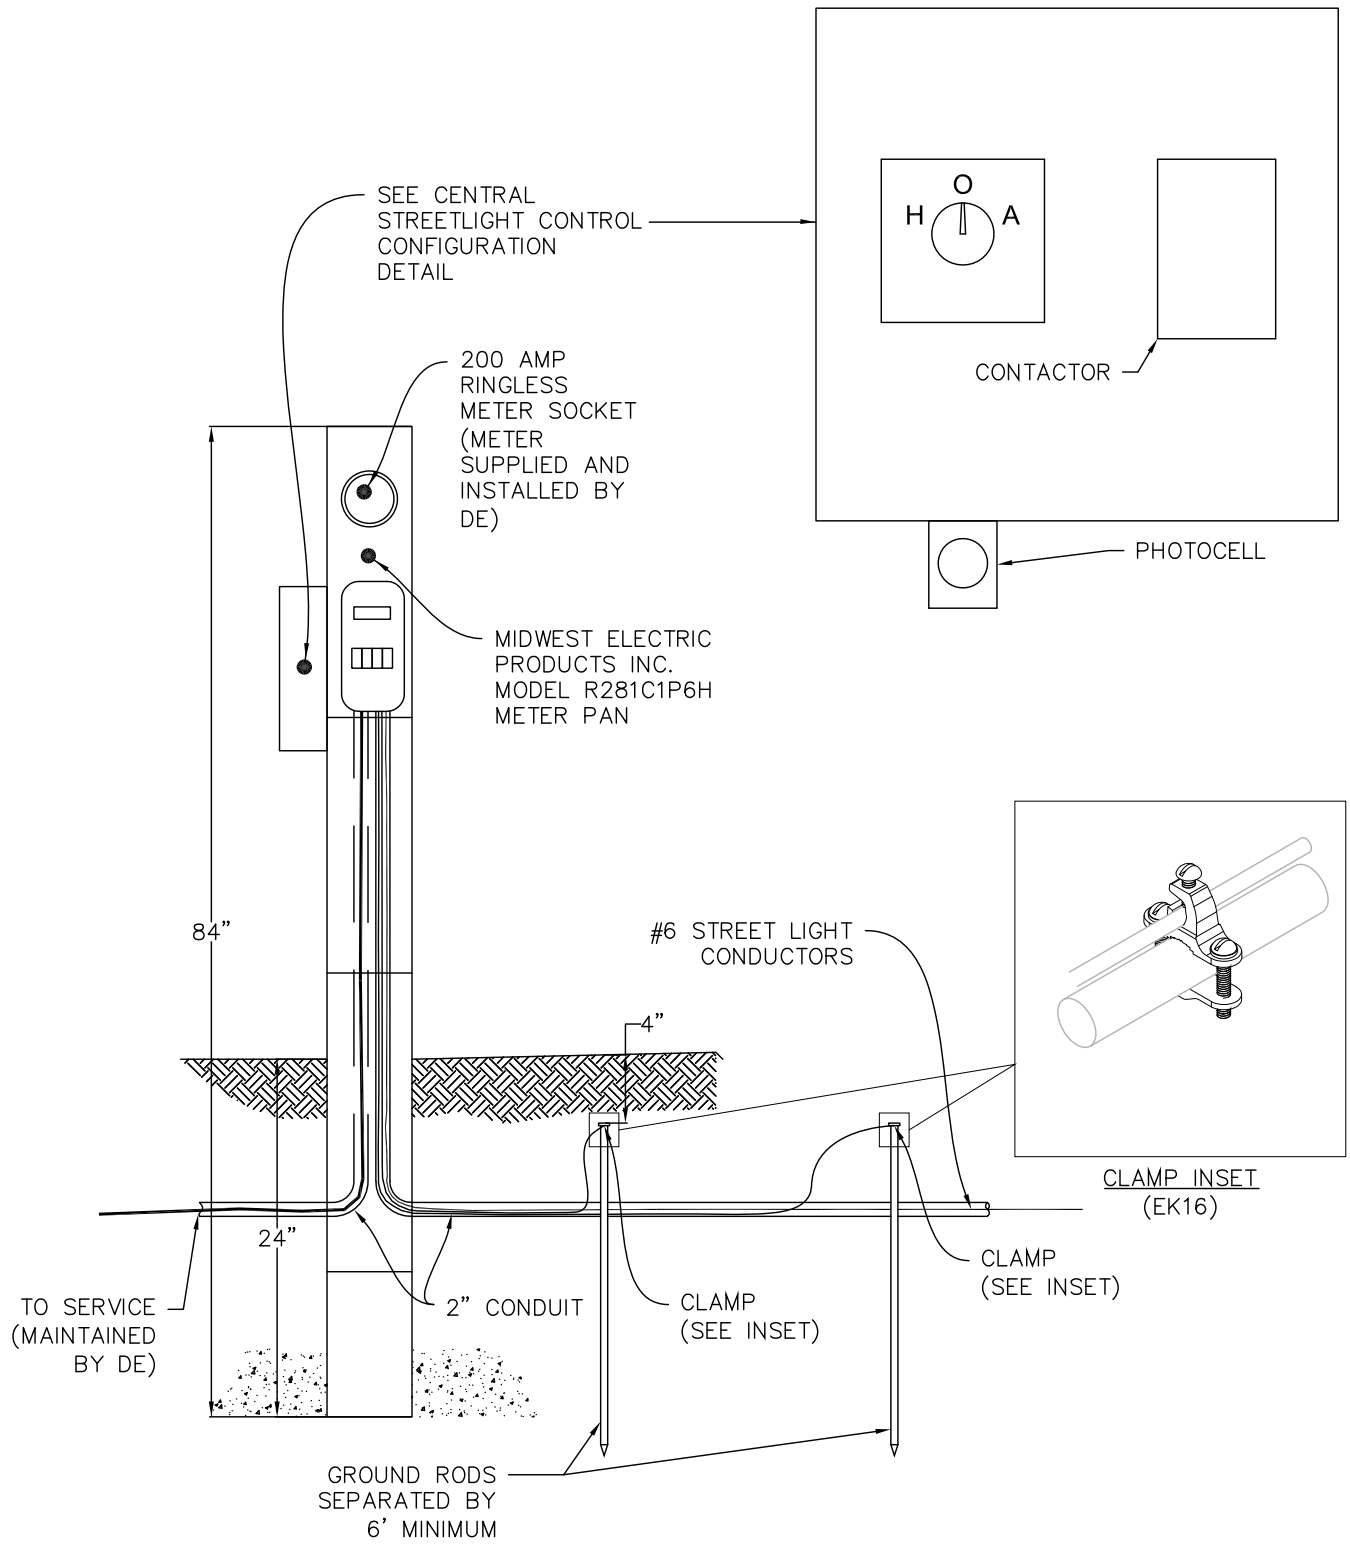

NOTES:

1. RESISTANCE TEST SHALL BE CARRIED OUT DURING THE METER PEDESTAL INSTALLATION.
2. MAXIMUM RESISTANCE SHALL NOT EXCEED 25 OHMS.

ELECTRICAL SERVICE

REVISION & DATE	

ARLINGTON
VIRGINIA

ARLINGTON COUNTY, VIRGINIA
DEPARTMENT OF ENVIRONMENTAL SERVICES

DRAWING NO.
14100-01